


LEGEND

-  ELECTRICAL SERVICES SWITCHBOARD.
-  SWITCHBOARD / CONTROL PANEL NOT PROVIDED AS PART OF THE ELECTRICAL SUBCONTRACT.
-  EXISTING POWER OUTLET AS NOTED.
-  SINGLE POWER OUTLET.
-  DOUBLE POWER OUTLET.
- EXIST

 EXISTING POWER OUTLET TO REMAIN AS IS, UNLESS NOTED OTHERWISE.
-  SIGNAGE CONNECTION.
-  SINGLE PHASE ISOLATOR.
-  THREE PHASE ISOLATOR.
-  HAND DRYER CONNECTION.
-  LIGHTING CONTROL SWITCH PANEL, TYPE x.
-  CIRCUIT LINE.
-  SWITCH LINE.
- DB-x - Py

 POWER CIRCUIT DESIGNATION. DENOTES DB AND CIRCUIT.
-  LIGHTING CONTROL CHANNEL REFERENCE.
-  ELECTRICAL EQUIPMENT AS NOTED.
-  REFER TO DETAIL NOTED FOR THE AREA SHOWN HATCHED. ADDITIONAL OUTLETS & FITTINGS MAY BE SHOWN ON DETAIL.
-  FIRE SMOKE DETECTOR.
-  FIRE ALARM SPEAKER.
-  FIRE ALARM DOOR INTERFACE.
- FIP

 FIRE INDICATOR PANEL.
- E1

 E1: GENERAL CEILING RECESSED LED EMERGENCY LIGHT, WHITE.
- EX

 EX: EMERGENCY LED EXIT LIGHT, WHITE.
- RD01

 RD01: EXISTING DOWNLIGHT TO BE REPLACED WITH NEW DALI DIMMABLE RECESSED DOWNLIGHT.
- RD02

 RD02: EXISTING DOWNLIGHT TO BE REPLACED WITH NEW DALI DIMMABLE RECESSED DOWNLIGHT.
- RD03

 RD03: EXISTING DOWNLIGHT TO BE REPLACED WITH NEW DALI DIMMABLE RECESSED DOWNLIGHT.
- RD04

 RD04: NEW RECESSED DALI DIMMABLE DOWNLIGHT.
- PD01

 PD01: EXISTING BISTRO PENDANT TO BE REPLACED WITH NEW.
- Sx

 Sx: LED JOINERY / CEILING STRIP LIGHT, TYPE AS NOTED.
- WL01

 WL01: BISTRO WALL LIGHT.
- WL02

 WL02: AMENITY WALL LIGHT.
- WL03

 WL03: GAMING WALL LIGHT.
- WL04

 WL04: EXTERNAL WALL LIGHT.
- GL01


 GL01: GARDEN STAKE LIGHT.
- G1

 G1: GAMING MACHINE BASE STRIP LIGHT BY THE GAMING ELECTRICIAN.
- F01

 F01: EXISITNG CEILING FAN.

EQUIPMENT:

- TEST - TEST PUSH BUTTON MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- RESET - RESET PUSH BUTTON MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- LAMP - AMBER TEST INDICATING LAMP MOUNTED ON THE DISTRIBUTION BOARD ESCUTCHEON.
- Ta - ADJUSTABLE 0-3 HOUR TIMED RELAY.
- Tb - 15 MINUTE RUN-ON TIMER TO OPERATE UPON THE RETURN OF MAINS POWER.
- Cx - CONTACTOR x.
- CRx - CONTROL RELAY x.
- Rx - RELAY x.

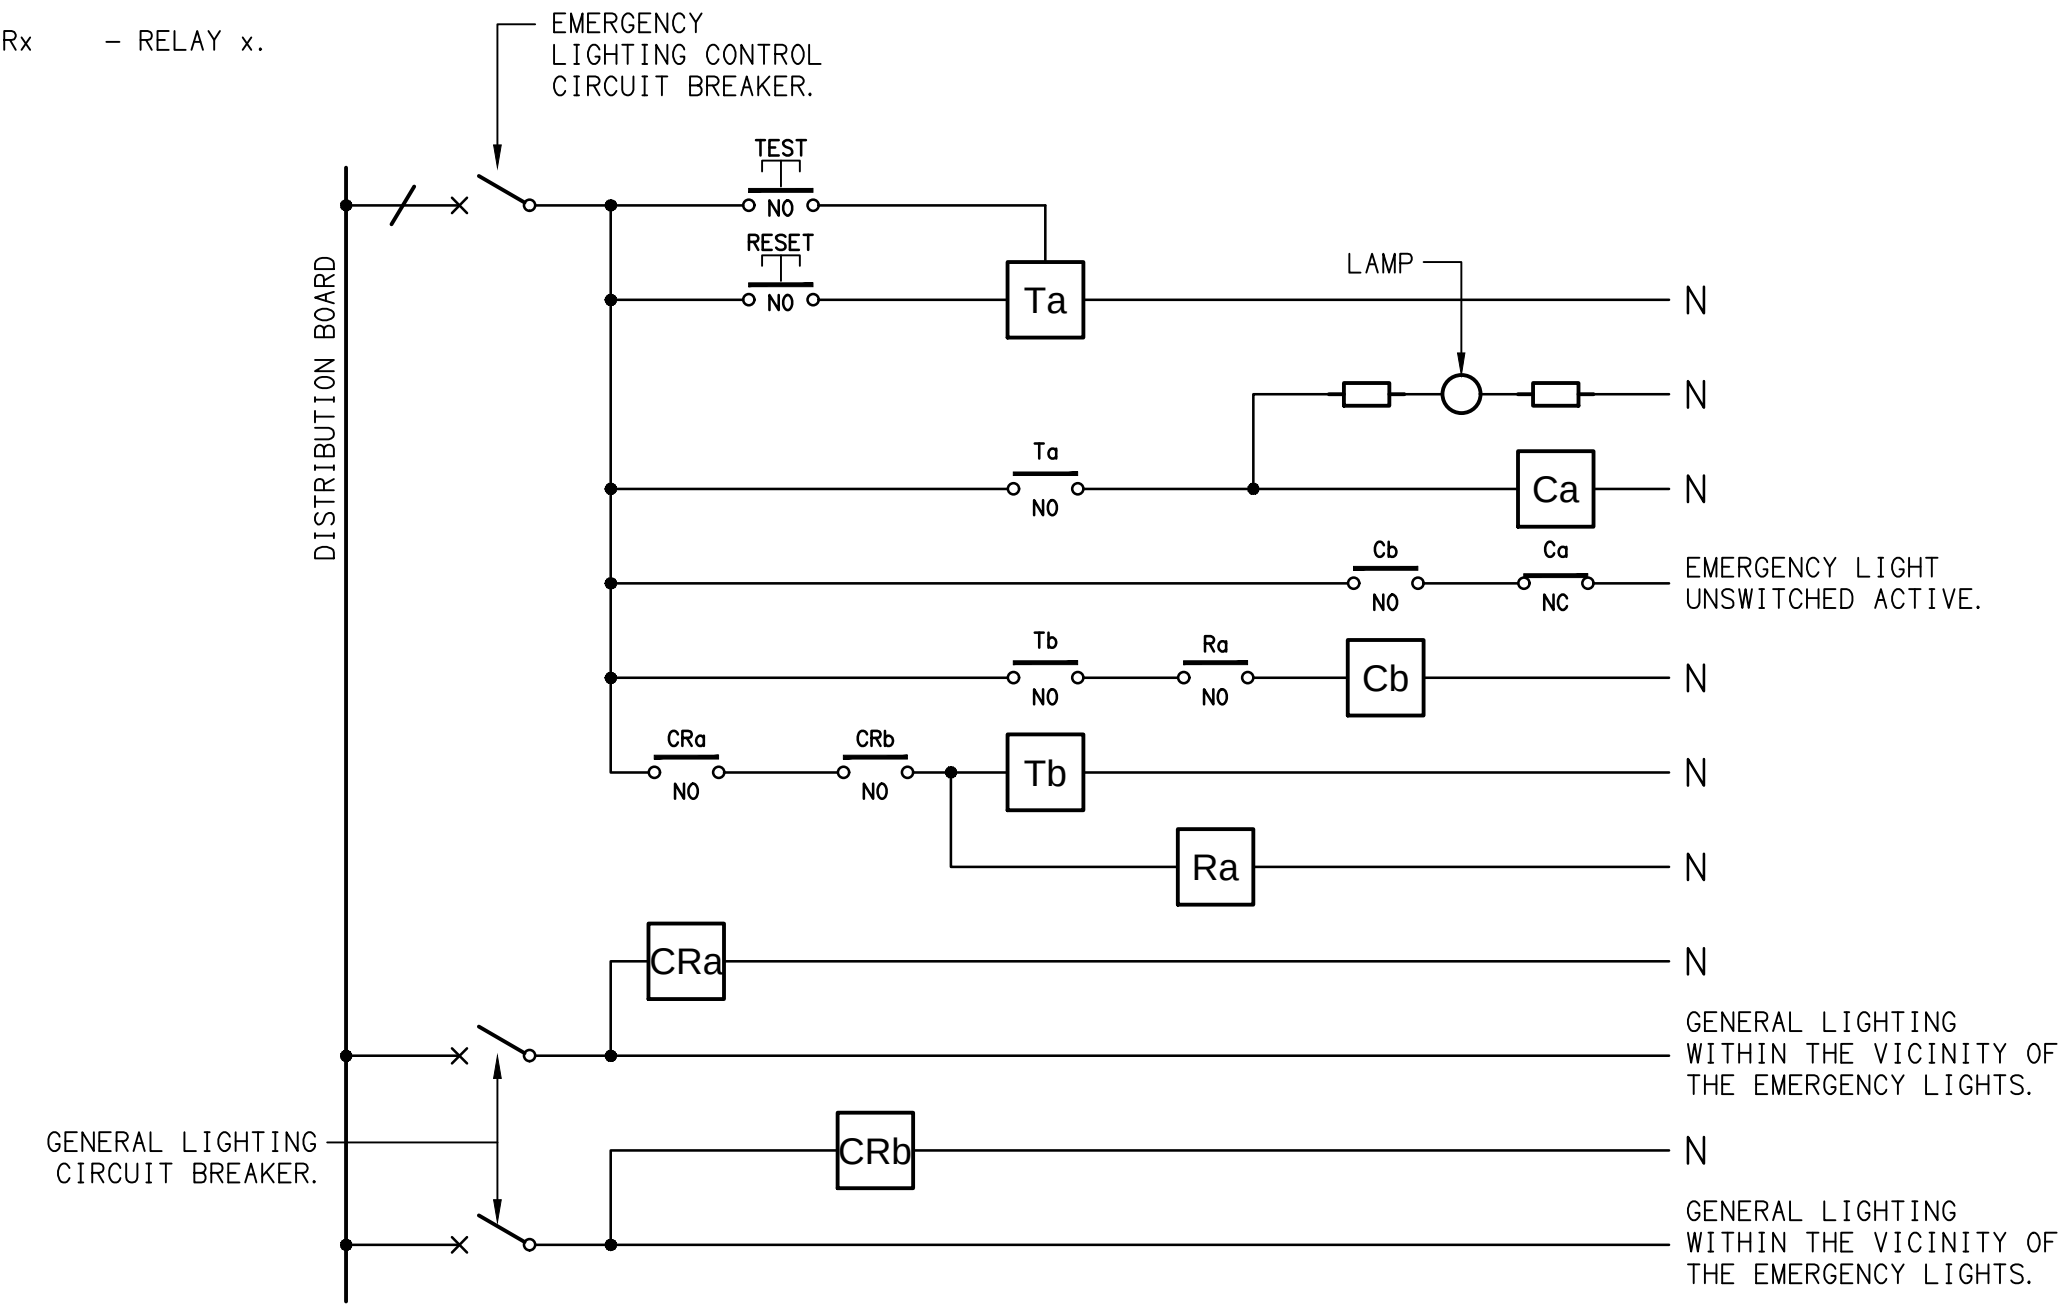


NOTES

1. THE EMERGENCY LIGHT UNSWITCHED ACTIVE / GENERAL LIGHTING SWITCHED ACTIVE CIRCUIT ARRANGEMENT AND CONTROL IS TYPICAL FOR ALL CIRCUITS SUPPLYING EMERGENCY LIGHTS.
2. PROVIDE ADDITIONAL CONTROL RELAYS (CRx) CONFIGURED AS PER CRa AND CRb FOR ALL ADDITIONAL LIGHTING CIRCUITS THAT SUPPLY LIGHTS IN THE VICINITY OF THE EMERGENCY LIGHTS.


SCHEMATIC

EMERGENCY LIGHTING
NOT TO SCALE

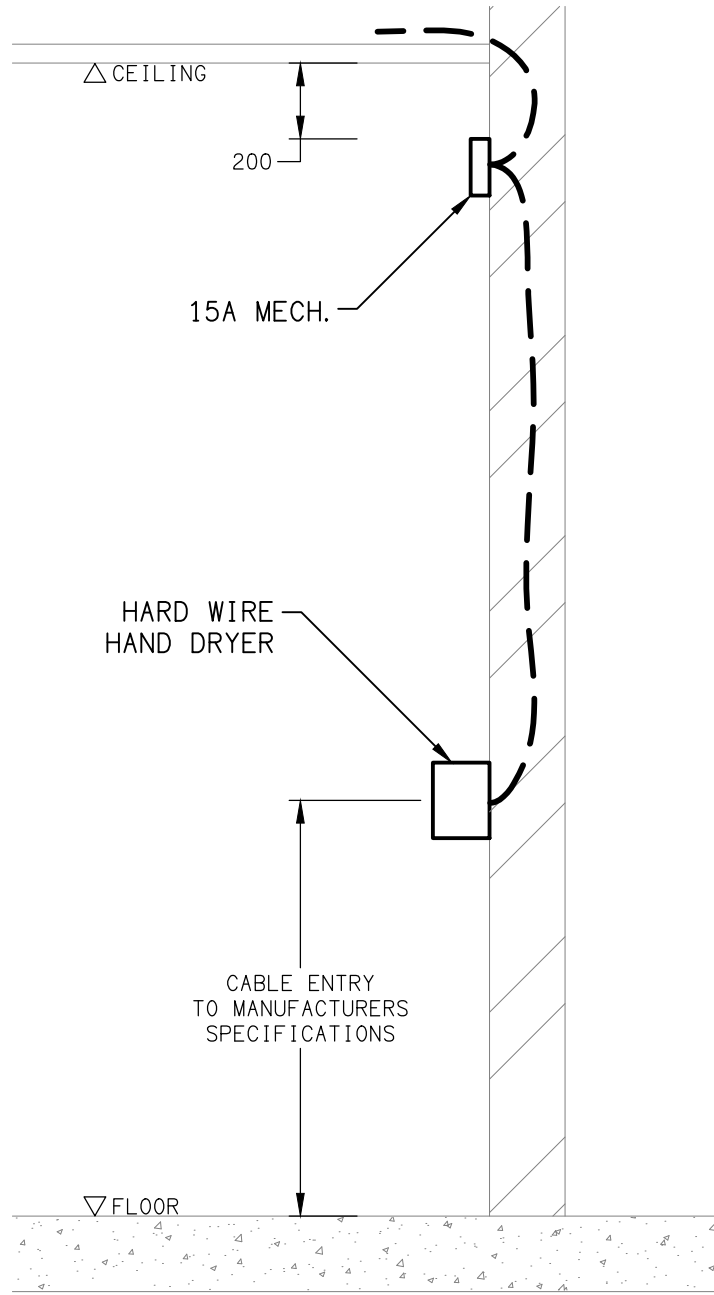

DETAIL

HAND DRYER CONNECTION
NOT TO SCALE

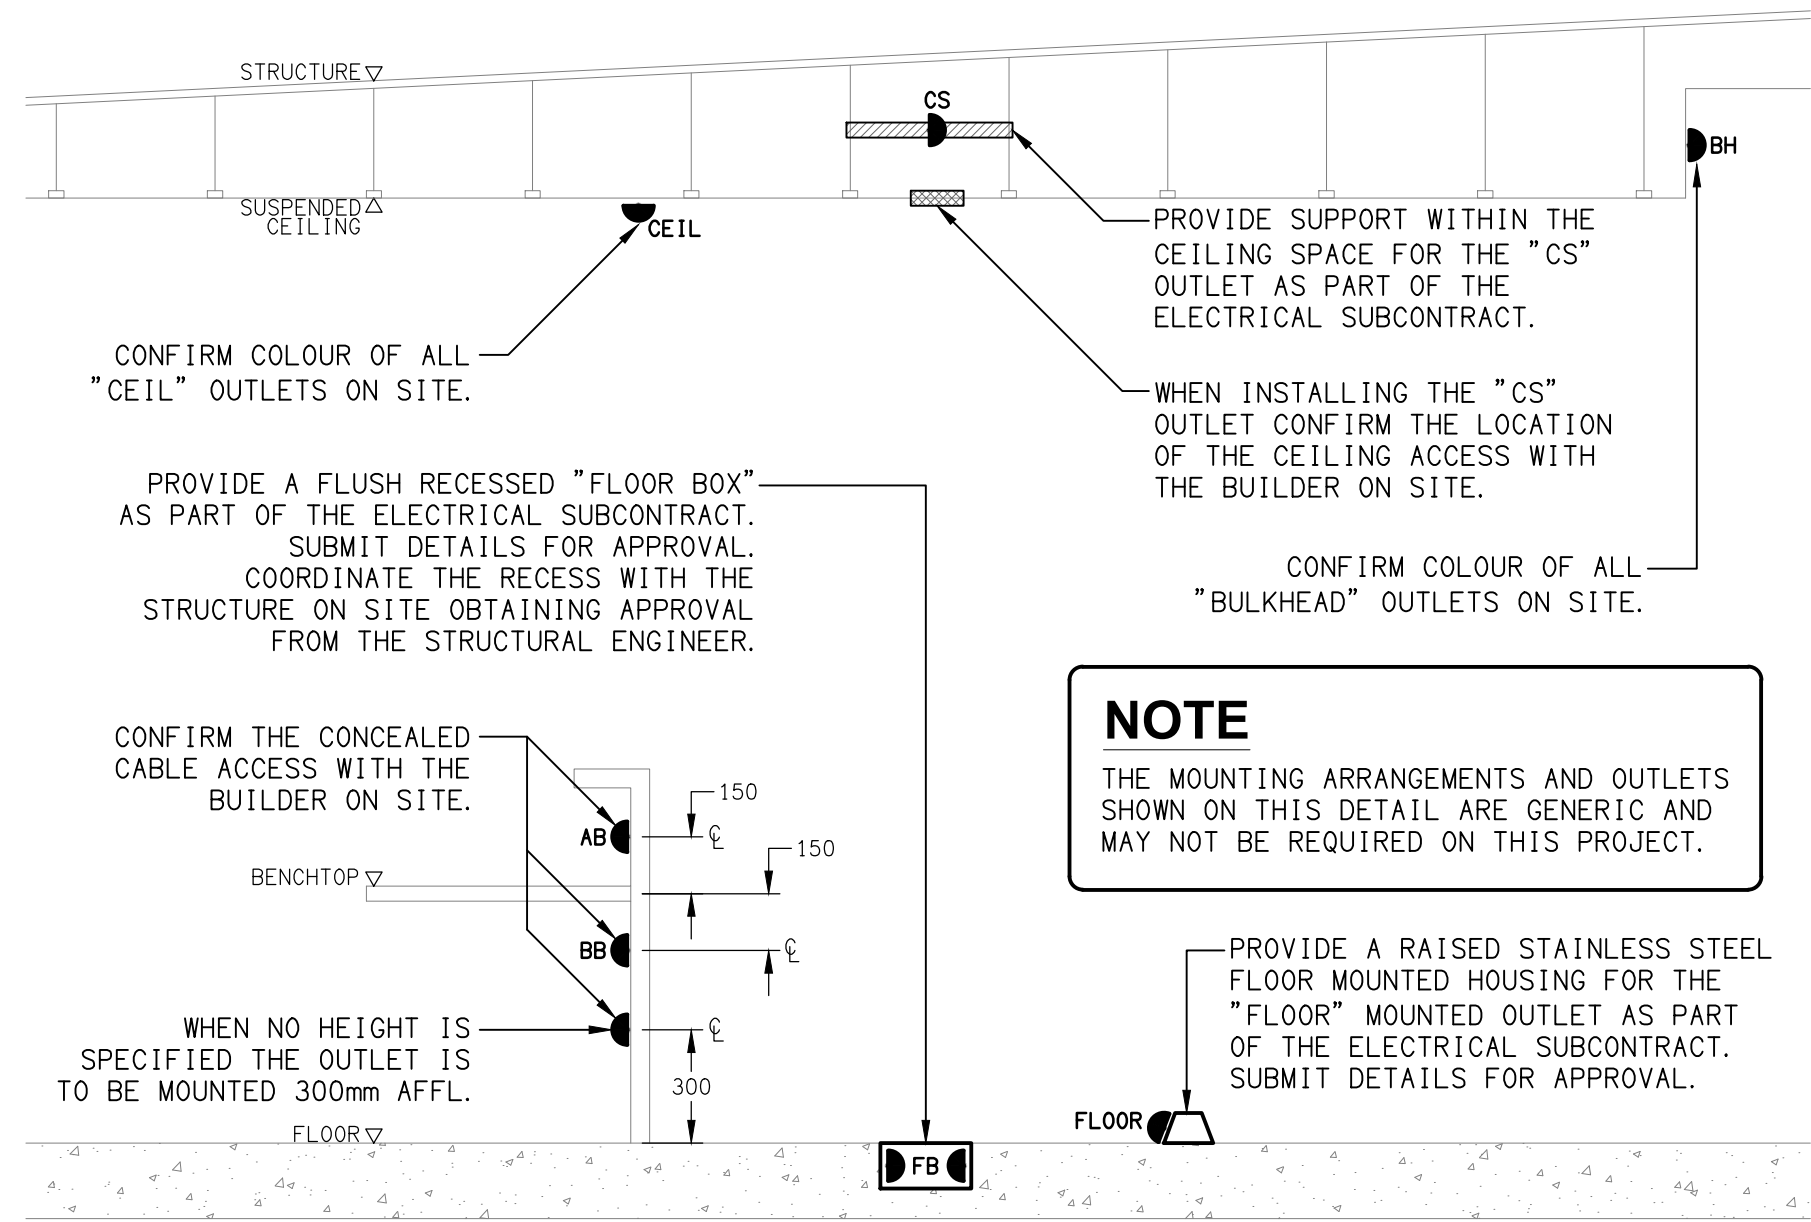

DETAIL

TYPICAL OUTLET MOUNTINGS
NOT TO SCALE

ELECTRICAL DESIGN GROUP BRISBANE PTY LTD ACN 092 710 793 TRADING AS: ELECTRICAL DESIGN GROUP		THE COPYRIGHT OF THIS DRAWING REMAINS THE PROPERTY OF THE ELECTRICAL DESIGN GROUP. USE FIGURED DIMENSIONS IN PREFERENCE TO SCALE. ALL DIMENSIONS TO BE VERIFIED ONSITE.		ELECTRICAL DESIGN GROUP ELECTRICAL BUILDING SERVICES CONSULTANTS BRISBANE GOLD COAST P.O.Box 15, Sherwood Q.4075 Phone: (07) 3278 4375 Email: brisbane@edg.net.au Web: www.edg.net.au		DRAWING: DALRYMPLE HOTEL 310 BAYSWATER ROAD, GARBUTT, QUEENSLAND		DRAWING: ELECTRICAL SERVICES LEGEND & DETAILS SCALE: NOT TO SCALE AT A1		PROJECT NO: C3760a DRAWING NO: E01 REVISION: A	
--	--	--	--	---	--	--	--	---	--	---	--