
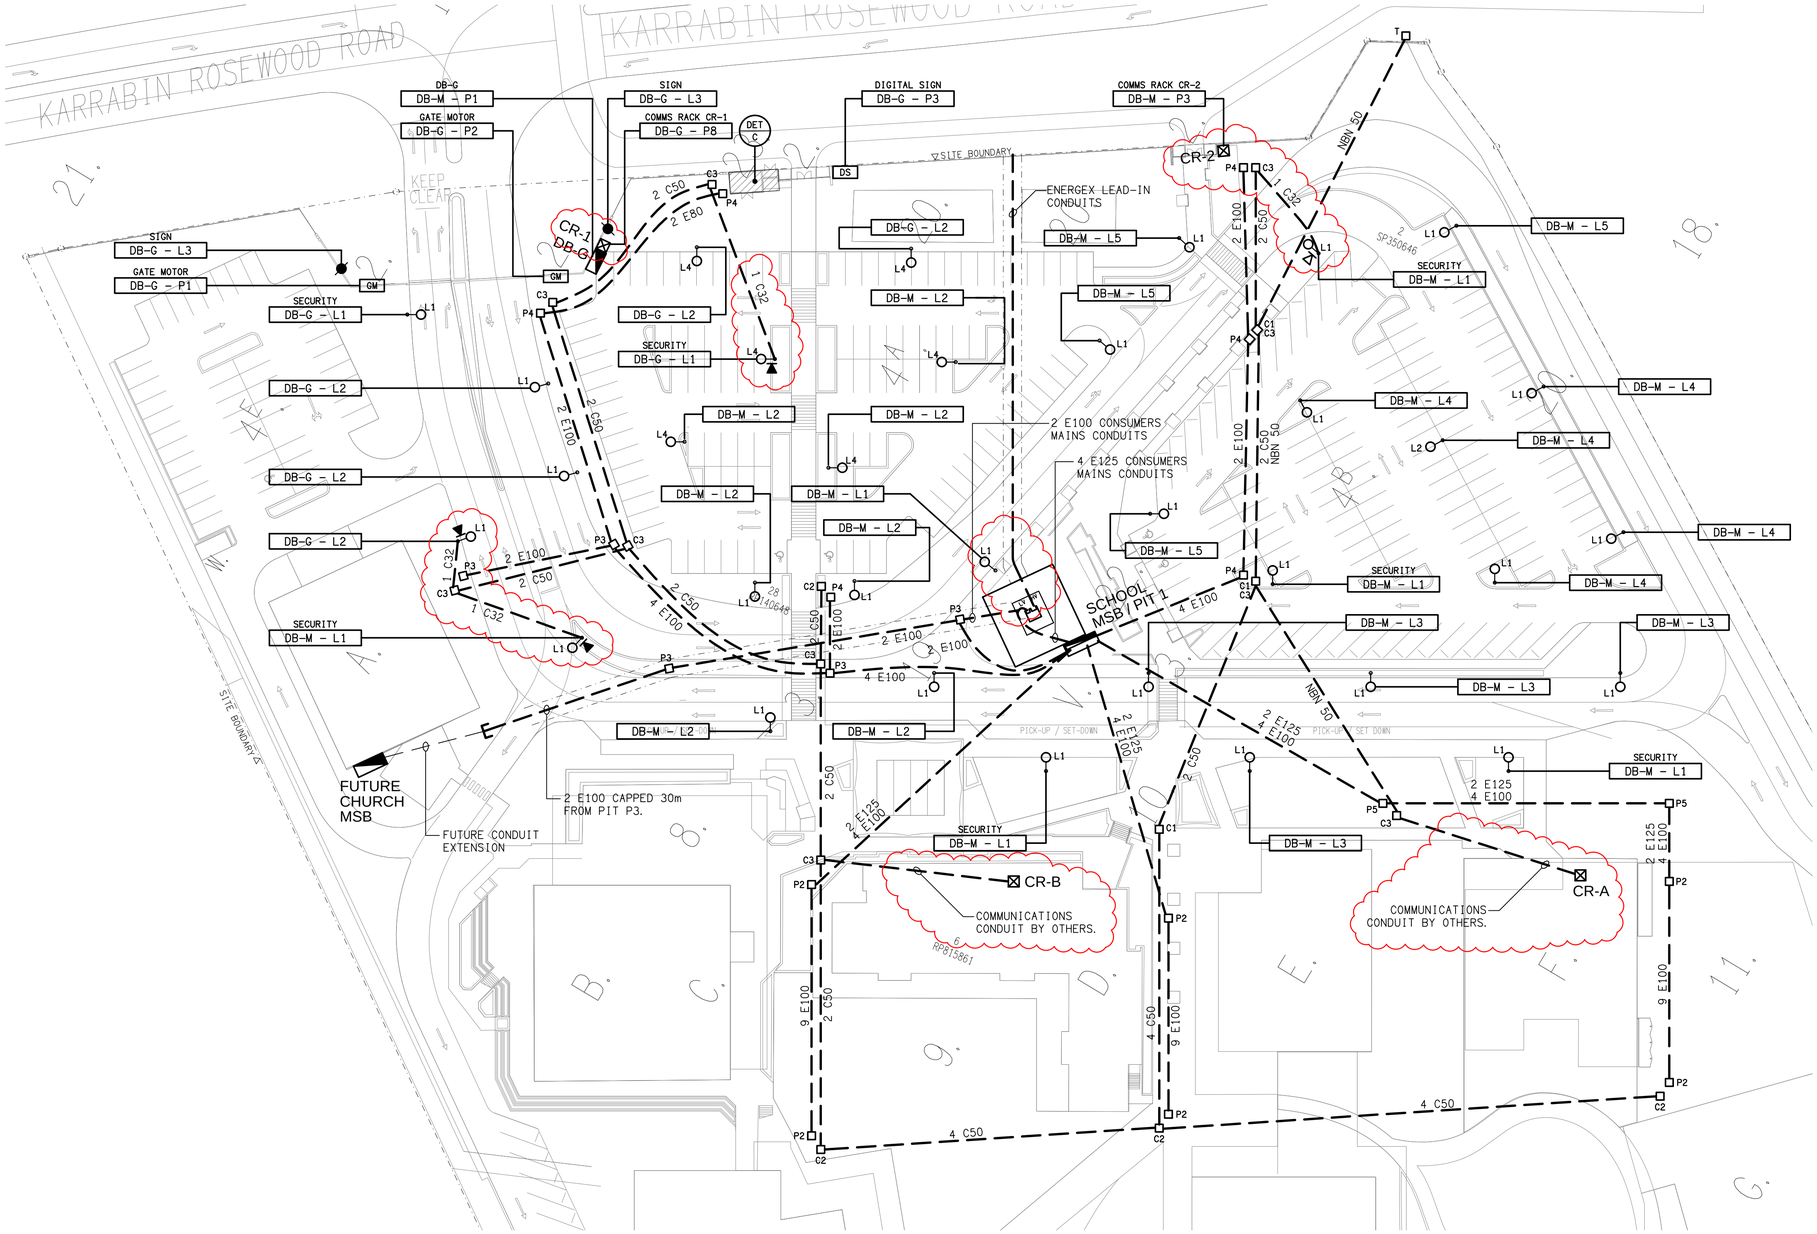
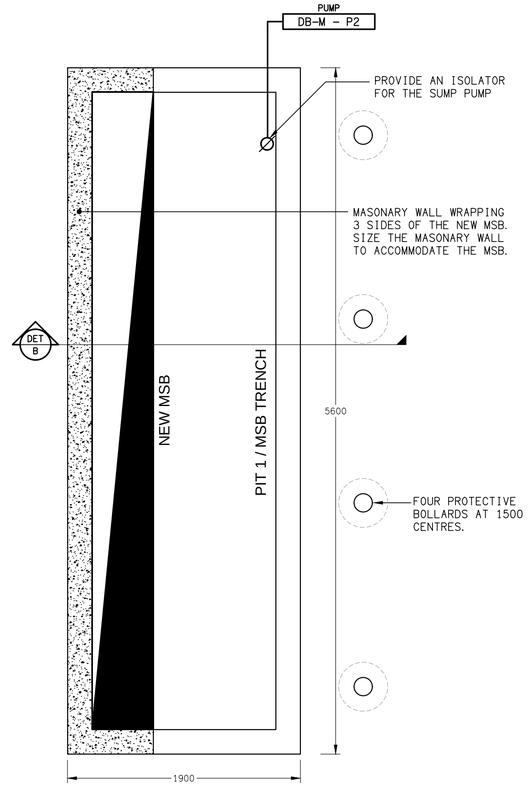



## DETAIL A
MSB / PIT 1 PLAN VIEW
SCALE 1: 25

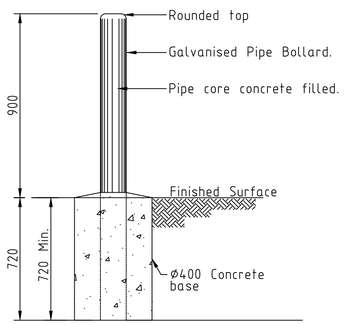


Galvanised Steel Bollard


**Bollards Around Padmounts**

Bollards shall be installed where padmounts are installed in car parks or other areas where padmounts are likely to be impacted by vehicles. The following outlines the minimum requirement for the design / installation of bollards: -


- Shall be manufactured of 5.6mm thick gal steel (medium)
- Circular tube min 140mm OD filled with concrete and capped.
- Buried 720mm in 400 x 400 x 720(D) concrete pad
- Installed 900mm above ground at 1.5m centers.

NOTES:

1. All materials and construction shall be in accordance with Australian Standards.
2. All concrete shall be minimum grade F'c=25MPa.
3. Galvanised pipe bollards may be painted to match the trim of surrounding dwellings.
4. A bollard will not be required provided a barrier such as a block wall, armco barrier or other permanent structure protects the PMT from vehicle traffic and likely impacts.

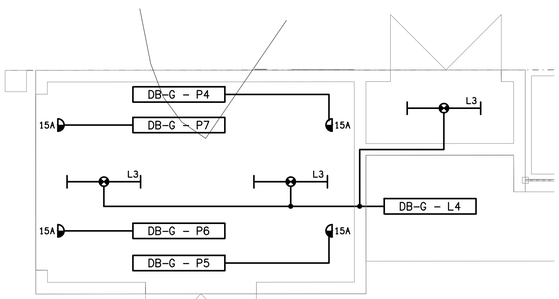


## DETAIL C
FIRE BOOSTER PLAN
SCALE 1: 50

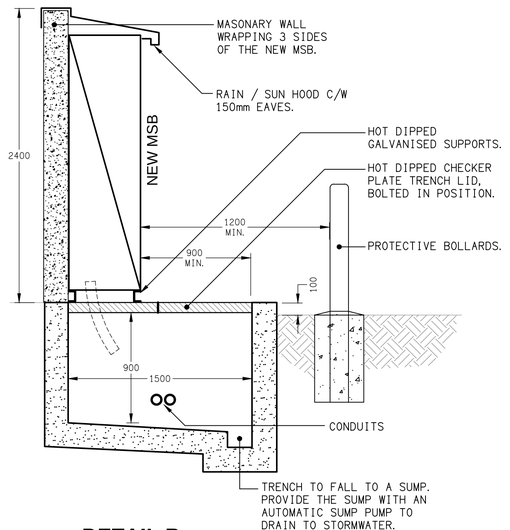


## DETAIL B
MSB / PIT 1 SECTION VIEW
SCALE 1: 25

| REV: | DESCRIPTION: | DATE: |
|---|---|---|
| E | CONSTRUCTION | 04/11/2026 |

ELECTRICAL DESIGN GROUP BRISBANE PTY LTD
ACN 092 710 793

TRADING AS:
ELECTRICAL DESIGN GROUP

THE COPYRIGHT OF THIS DRAWING REMAINS THE PROPERTY OF THE ELECTRICAL DESIGN GROUP.

USE FIGURED DIMENSIONS IN PREFERENCE TO SCALE.

ALL DIMENSIONS TO BE VERIFIED ONSITE.

**ELECTRICAL DESIGN GROUP**
ELECTRICAL BUILDING SERVICES CONSULTANTS
BRISBANE GOLD COAST

P.O.Box 15, Sherwood Qld 4075
Phone: 0418 893 338
Email: brisbane@edg.net.au
Web: www.edg.net.au

PROJECT:
KINGS CHRISTIAN COLLEGE
WALLOON STAGE 1 PROJECT 2 WAL01

636 KARRABIN ROSEWOOD ROAD, WALLOON

DRAWING:
**ELECTRICAL SERVICES**
SITE SERVICES PLAN

| SCALE: | AT | PROJECT NO: | DRAWING NO: | REVISION: |
|---|---|---|---|---|
| 1:500 UNO | A1 | C3808a | E04 | E |